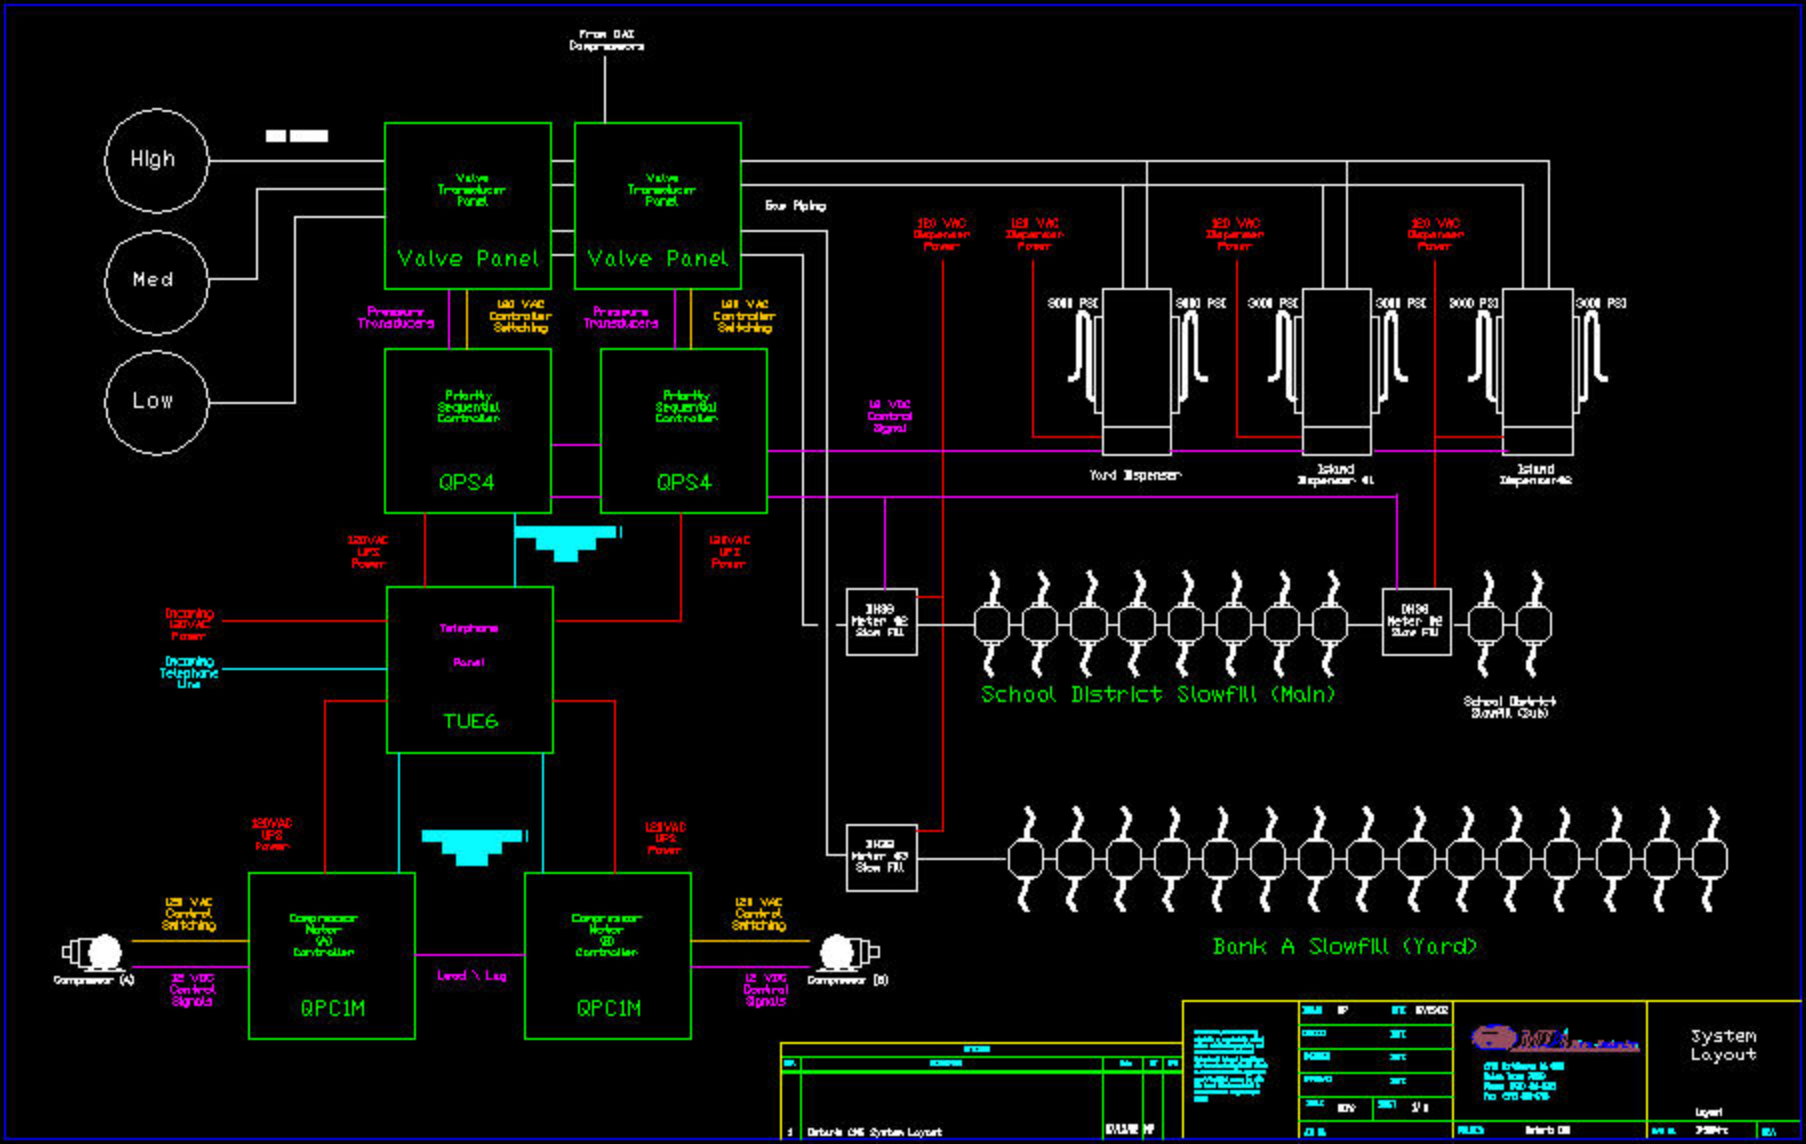
From OAC Compressors
High
Med
Low
Valve Transducer Panel
Valve Panel
Valve Transducer Panel
Valve Panel
Gas Piping
120 VAC Dispenser Power
120 VAC Dispenser Power
120 VAC Dispenser Power
120 VAC Dispenser Power
Pressure Transducers
120 VAC Controller Switching
Pressure Transducers
120 VAC Controller Switching
3000 PSI
3000 PSI
3000 PSI
3000 PSI
3000 PSI
3000 PSI
Priority Sequential Controller
QPS4
Priority Sequential Controller
QPS4
12 VDC Control Signal
Yard Dispenser
Island Dispenser #1
Island Dispenser #2
120VAC UPS Power
120VAC UPS Power
Incoming 120VAC Power
Incoming Telephone Line
Telephone Panel
TUE6
Meter #2 Slow Fill
Meter #2 Slow Fill
School District Slowfill (Main)
School District Slowfill (Sub)
120VAC UPS Power
120VAC UPS Power
Meter #3 Slow Fill
Bank A Slowfill (Yard)
120 VAC Control Switching
120 VAC Control Switching
Compressor Motor (A) Controller
QPC1M
Compressor Motor (B) Controller
QPC1M
Level \ Lag
Compressor (A)
Compressor (B)
12 VDC Control Signals
12 VDC Control Signals
System Layout