

"Smart" Radar Explosion Proof 2 Wire Measurement Sensors"



730 The Kingsway Peterborough, Ont. K9J6W6 Canada
 Tel: (705) 740 – 2010 Web: www.abmsensor.com
 Fax: (705) 740 – 2563 E-mail: info@abmsensor.com

FEATURES

2 Wire Operation
 Self Adjusting Tracking Radar
 Output 4-20 mA / 20- 4 mA
 For communications with calibration,
 diagnostics & data logging software
 Communication with "HART 7"

APPLICATIONS

Water / Wastewater
 Chemicals with vapors

MECHANICAL

Conduit Entry : 1/2" NPT
 Enclosure : Aluminum /S.S.- 94V0
 Ingress Protection : TYPE 4/4X ,
 NEMA 4 (IP65)

ENVIRONMENTAL

Approvals :FMc for Can. & US Explosion Proof
 Class I, Div.1, Groups B, C, D:
 Dust-Ignition Proof Enclosure for
 Class II/III Div. 1,Groups E, F, G
 Approvals : FCC Part 15 - Low
 Power Communication Device
 Temperature : - 40 to 140°F (- 40 to 60°C)
 Installation Category : Class II
 Catalogue # - On the Web return to Home Page & refer to
 Catalogue Number Structure for ordering information. In
 Product Documentation refer to page 5.

TECHNICAL SPECIFICATIONS

Radar Range Code	RANGE In Liquids	RESOLUTION	MOUNTING
017	* - 17 ft. * - 5 m	0.08" 2.0 mm	2.0",1 1/2" NPT **
033	* - 33 ft. - 10 m	0.15" 3.9 mm	2.0",1 1/2" NPT **
050	* - 50 ft. * - 15 m	0.22" 5.7 mm	2.0",1 1/2" NPT **
100	* - 100 ft. * - 30 m	0.44" 11 mm	2.0",1 1/2" NPT **
140	* - 140 ft. * - 42 m	0.62" 15.7 mm	2.0",1 1/2" NPT **
240	* - 240 ft. * - 73 m	1.06" 26 mm	2.0",1 1/2" NPT **

Note - * Minimum Range starts at the lower tip of the antenna for high dielectric material (water). For low dielectric materials allow longer Minimum Range.


Note -**Only 2" and 3"NPT Mtg. Connection Available on High Temperature Radar.

OPTIONAL

Antenna Extension : 6" or 8" Lengths
 - Use only with Teflon Antenna !
 - Refer to catalogue number Page for ordering info.
 High Temperature Unit :
 - 2" / 1 1/2" NPT Process Connection
 - Teflon De-coupler threads on with 2" NPT Process Connection.



Antenna Extension

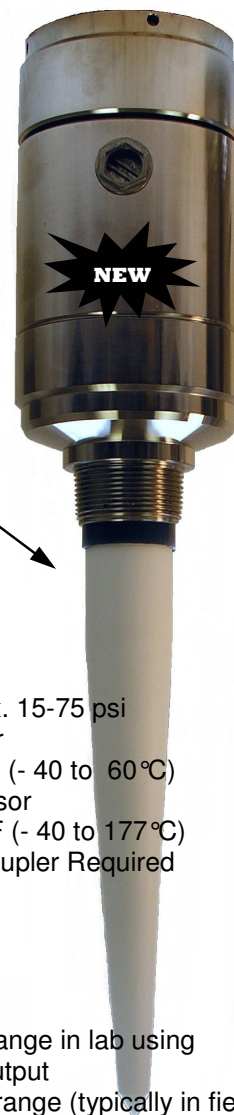

PROCESS

Material Dielectric : Er >2
 Pressure : 5 bar Max. 15-75 psi
 Temperature : - Std. Sensor
 PP Rod : - 40 to 140°F (- 40 to 60°C)
 High Temp. Optional Sensor
 PTFE Rod : - 40 to 350°F (- 40 to 177°C)
 Teflon Temperature De-coupler Required

OPERATIONAL

Operation : Pulse Radar
 Accuracy : +/- 0.1% of max. range in lab using
 4-20mA current output
 +/-0.25% of max. range (typically in field)
 Frequency : 6.3 GHz
 Loss of Echo Hold : 1 min., 22mA or 2mA output
 Transmitter Power : 50 uW average
 Calibration : via optional communications port.
 (required)
 Diagnostics: (Echo Profile) via communications port
 Antenna : Dielectric rod PP or Optional PTFE

ELECTRICAL SPECIFICATIONS

Power DC 16 to 30 VDC ,
 ABM200 R load max. = (Vs - 14) / 25 mA


Output 4-20 mA Output 6.1 uA resolution

2 Wire Radar Ex. Sensors User Instruction Manual




730 The Kingsway Peterborough, Ont. K9J6W6 Canada
Tel: (705) 740 - 2010 Web: www.abmsensor.com
Fax: (705) 740 - 2563 E-mail: info@abmsensor.com

Fig. # 1 - "2 Wire Sensor" Wiring Connection

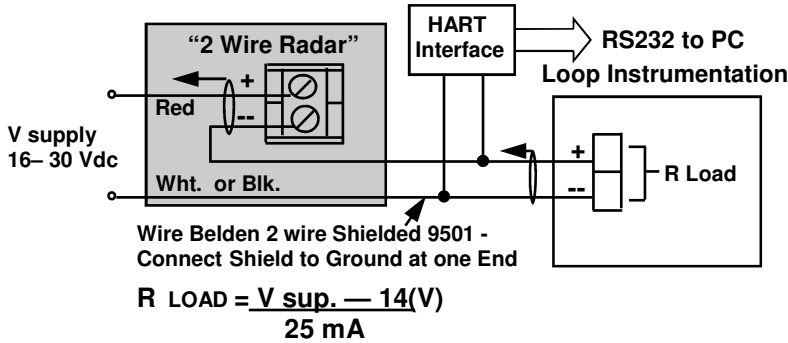

Top View of Sensor (Access Cover Removed)

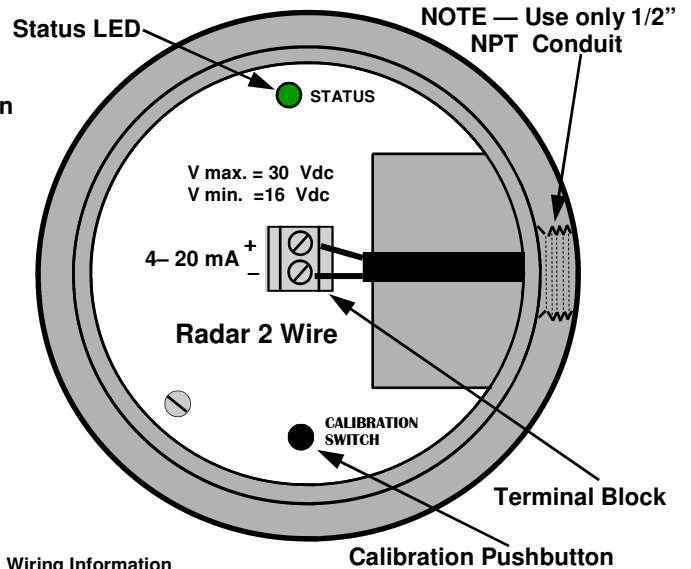

Wiring Information

- Ground shield at one end only.
- All terminal block wiring must be rated for 250V.
- Terminal is for use only with equipment which has no live parts which are accessible .
- Terminal is for use with equipment which maintains basic insulation from hazardous voltage under normal and single fault conditions .
- Connection used at the remote end of external circuit .

Recommended Wiring

- 2 Wire shielded 24 AWG , 300 V

For Radar programmable using communication is recommended

- 1) Load "ABM_HART_GatewayPC" into your PC.
(Select SETUP.EXE from CD and follow instructions on the screen.)
- 2) Click on START and under PROGRAMS select ABM_HART_GatewayPC.
- 3) Follow instruction in help file.

Calibration — 4 -20 or 20 - 4 mA Output

FULL — Calibrate 20 mA or 4mA (Set Near Target)

1. Calibration mode LED color is blinking Green.
(for Radar Low Dielectric Materials has to be off)
2. Push button and hold until LED turns Yellow (20 mA) or push button and hold until LED turns Red (4 mA)
3. Release button, observe LED flashes to acknowledge the calibration.

EMPTY— Calibrate 4 mA or 20 mA (Set Far Target)

1. Calibration mode LED color is blinking Green
(for Radar Low Dielectric Materials has to be off)
2. Push button and hold until LED turns Red (4 mA) or push button and hold until LED turns Yellow (20 mA)
3. Release button, observe LED flashes to acknowledge the calibration.

For Radar to turn the Low Dielectric Materials operation mode

ON and OFF (this mode is recommended for materials with dielectric constant lower than 4 and also to eliminate multiple reflections in tank.)

- 1) To turn the Low Dielectric Materials ON. Push button and hold until LED goes OFF after the sequence of Yellow , Red and turns Off. The Low Dielectric Material operation is ON when the LED'S Green light gives two short blinks.
- 2) To turn the Low Dielectric Materials OFF. Push button and hold until LED goes OFF after the sequence of Yellow , Red and Turns OFF. The Low Dielectric Material operation is OFF when LED is blinking Green.
- 3) Use "Hart" communication software.


FCC INFORMATION TO RADAR USERS

NOTE: This equipment has been tested and found to comply with the limits for a Class A digital device, pursuant to Part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instruction manual, may cause harmful interference to radio communications. Operation of this equipment in a residential area is likely to cause harmful interference in which case the user will be required to correct the interference at his own expense.

WARNING- Changes or Modifications not expressly approved by ABM Sensor Technology Inc. could void the user's authority to operate the equipment.

Typical Installation

- 1) Radar unit must be installed into metal fitting with the antenna pointing downward.


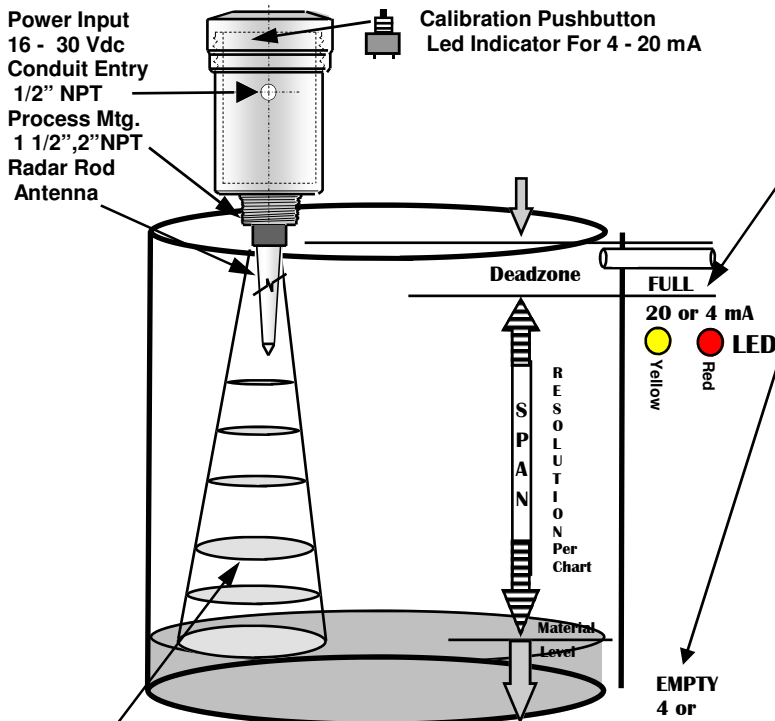


Operation - electromagnetic pulse is transmitted from the ABM sensor . The pulse travels to the surface being monitored and is reflected off this surface back to the sensor . The time of flight is divided by 2 and converted to an output signal directly proportional to the material level .

2 Wire Explosion Proof Radar Level Measurement Sensors Outline Dimensional Dtl.



730 The Kingsway, Peterborough, Ont. K9J6W6 Canada
 Tel. (705) 740 - 2010 Web: www.abmsensor.com
 Fax. (705) 740 - 2563 E-mail: info@abmsensor.com

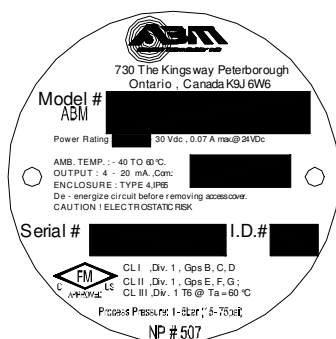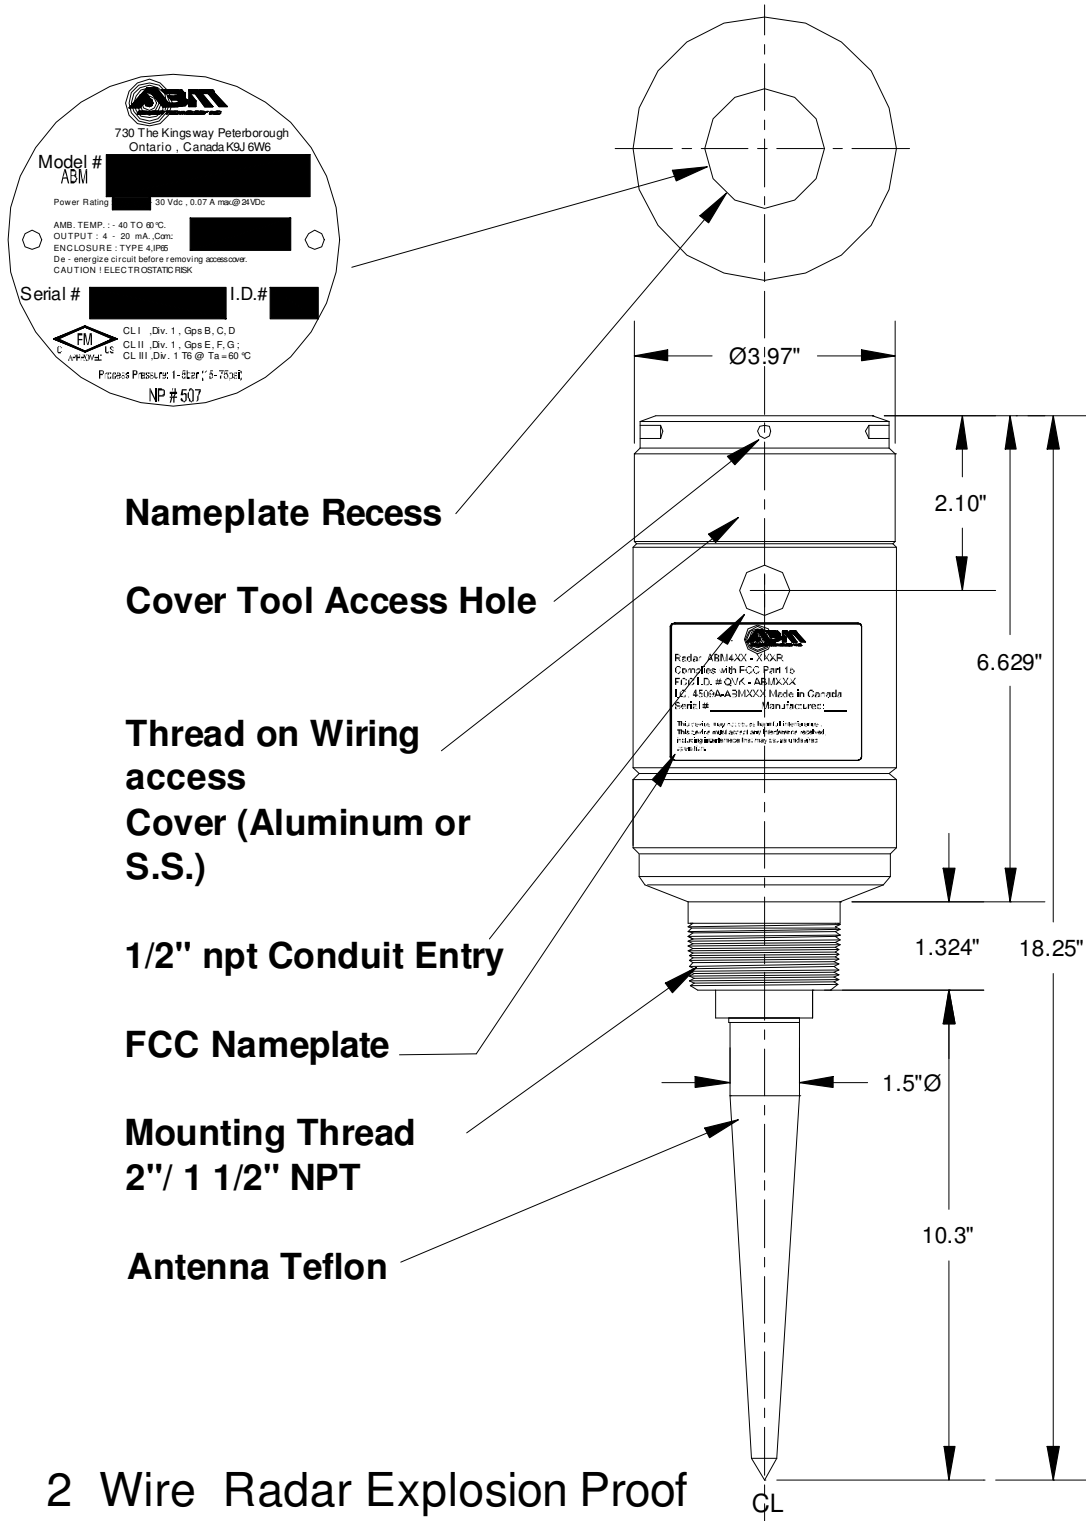


2 Wire Radar Explosion Proof Outline Dimensions

Radar Standard and Exp. Proof Sensors c/w Horn Dimensional Dtl.



730 The Kingsway Peterborough, Ont. K9J6W6 Canada
 Tel: (705) 740 - 2010 Web: www.abmsensor.com
 Fax: (705) 740 - 2563 E-mail: info@abmsensor.com

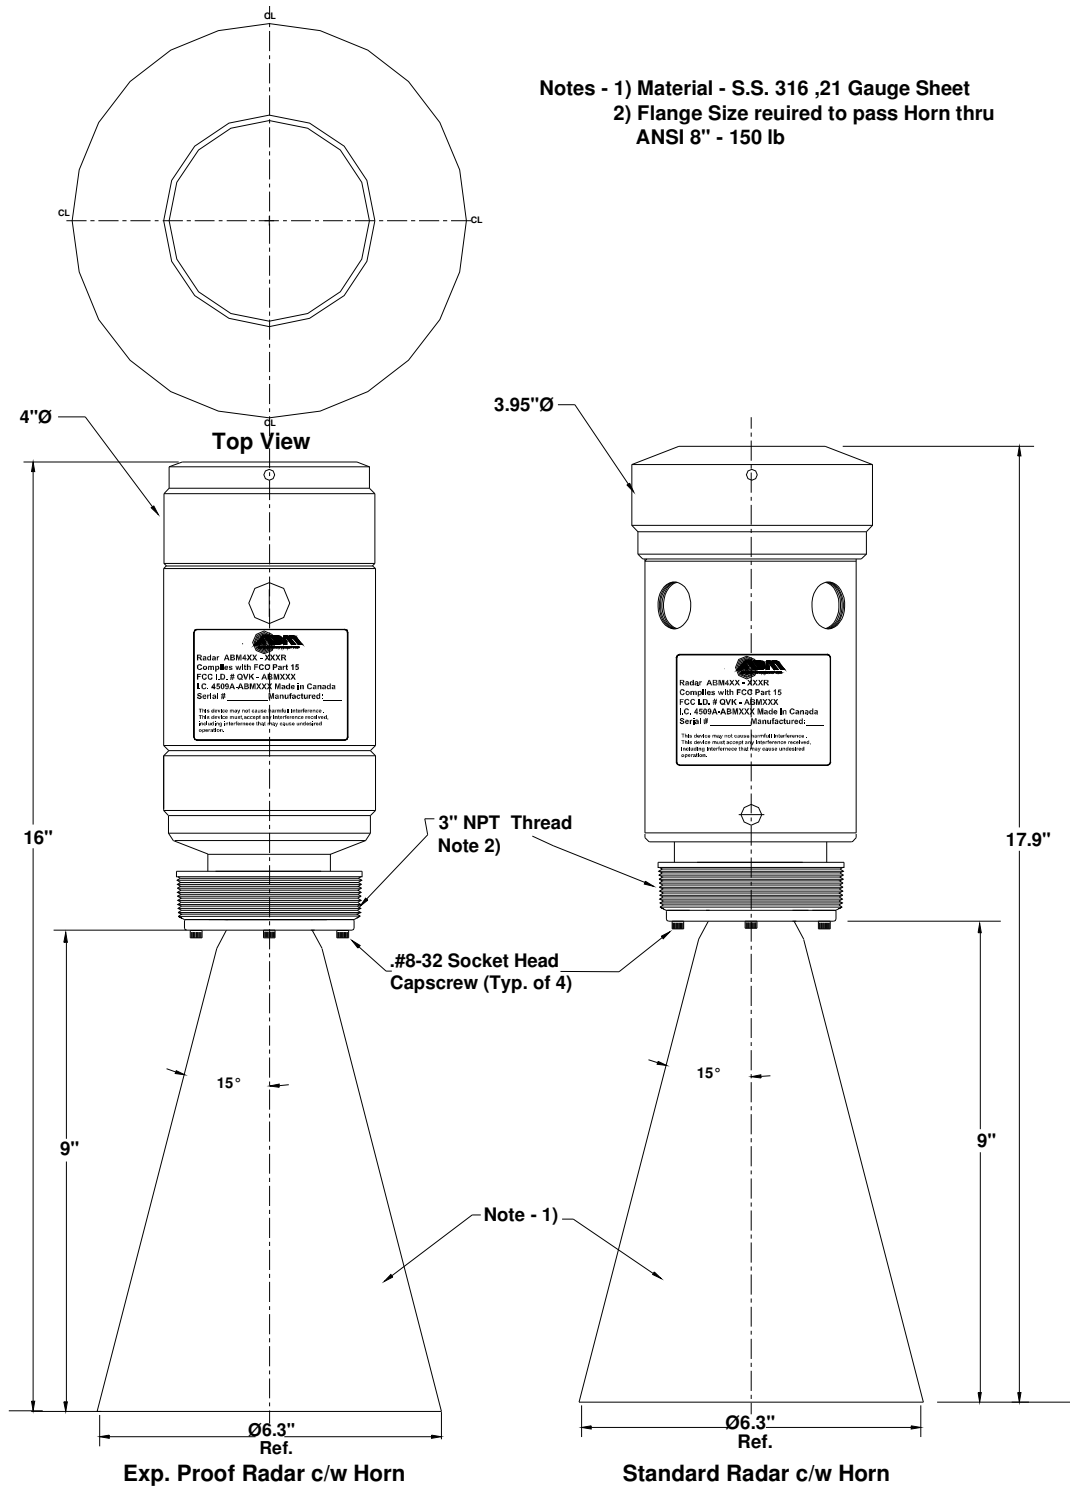

- Notes - 1) Material - S.S. 316 ,21 Gauge Sheet
- 2) Flange Size required to pass Horn thru ANSI 8" - 150 lb

2 ,3 & 4 Wire Radar Level Sensor with Horn Outline Detail